



## LINN COUNTY PLANNING AND BUILDING DEPARTMENT

Steve Wills, Director  
Rick Goff, Building Official

---

Room 114, Linn County Courthouse  
PO Box 100, Albany, Oregon 97321  
Phone 541-967-3816 Fax 541-926-2060  
[www.co.linn.or.us](http://www.co.linn.or.us)

### Commercial Submittal Requirements

Linn County approvals must be obtained before a building permit can be issued.

#### 1. LAND USE APPROVAL:

- a) If your building project is within a city, you must obtain land use approval from the city.
- b) If your building project is within Linn County and not within the city limits, land use approval must be obtained from the Linn County Planning and Building Department.

Note: Some planning reviews or hearings may delay your project. You should begin this process well before you wish to start building. Talk to the city or county planner about your project for specific requirements.

#### 2. SANITATION:

- a) If your property is served by a municipal sewer system, approval must be obtained from the municipality.
- b) If a public system is not available, an on-site sewage disposal system may be used. For information regarding an existing or new disposal system, contact Environmental Health at (541) 967-3821. Please contact this department regardless of the type of proposed structure.

Note: Some delay may be experienced in obtaining sanitation approval. You should begin this process well before you wish to start building. Talk to a sanitarian about your project for specific requirements.

#### 3. ROADS AUTHORITY:

- a) Prior to submitting for a permit, obtain approval from one of the following: Linn County Road Department at (541) 967-3919, Oregon Department of Transportation at (503) 986-3435, or your local municipality.

#### 4. FIRE AUTHORITY:

- a) Comments from the local fire authority must be provided at the time of permit submittal. Complete the Access & Water Supply worksheet and include the form, with a signature from the local fire authority, as part of your permit application materials.

#### 5. BUILDING PLAN REVIEW:

- a) Residential: See Requirements and Submittals Checklist.
- b) Commercial: See Requirements and Submittals Checklist. A pre-application meeting may be required for commercial or industrial building projects. Contact the Linn County Building Official for this determination.

# Commercial Submittal Requirements & Checklist



Linn County Planning & Building Department  
300 SW 4<sup>th</sup> Avenue (Physical) PO Box 100 (Mailing)  
Albany, OR 97321 Albany, OR 97321

Phone (541) 967-3816  
Fax (541) 926-2060  
<http://www.co.linn.or.us>

*Use the following checklist to ensure all necessary information has been provided. Failure to submit all requirements will result in plan review delays for your project and your application for plan review may be denied until all requirements are submitted. Check each box or mark N/A.*

## Forms required at submittal:

*The following forms, documents, and plans are to be submitted when applicable for commercial projects:*

- Completed Construction Permit Application.
- Completed Commercial Submittal Requirements Checklist (this form)
- Completed and signed Electrical, Mechanical, and Envelope COMcheck Forms as applicable. Forms found at <http://www.energycodes.gov/comcheck>.
- Completed Emergency Responder Radio Coverage (ERRC) Checklist for all new construction.
- Completed and signed Special Inspection Agreement if applicable; see Specific Requirements-Special Conditions item 2 of this form.
- Completed and signed Deferred Submittal Agreement if choosing to defer items required for review.
- Completed and signed Phased Construction Agreement if choosing to phase construction or occupancy.
- Suite layout if structure includes suites or if the site includes multiple buildings; see Specific Requirements – Special Conditions item 11 of this form.
- Vicinity map.
- Asbestos survey and/or abatement report if any demolition will occur in conjunction with the renovation.

To view Oregon codes online visit [http://www.cbs.state.or.us/external/bcd/programs/online\\_codes.html](http://www.cbs.state.or.us/external/bcd/programs/online_codes.html)

## Structural Design Criteria

- *Snow Loads* (OSSC section 1608): 20 psf minimum roof snow load, 25 psf ground snow load (less than 4,000 ft. elevation).
- *Wind Loads* (OSSC section 1609): Ultimate wind speed – Risk Category (Cat.) I – 100 mph, Cat. II – 110 mph, Cat. III & IV – 115 mph, Normal wind speed Cat. I – 78 mph, Cat. II – 85 mph, Cat. III & IV – 90 mph, Exposure B or C.
- *Earthquake Loads* (OSSC section 1613): Site Class D.
- Seismic Design Category D.
- *Frost Protection* (OSSC sections 1809.5 & 1904.1) *Frost Depth*: 12 inches, *Frost Exposure*: Moderate.

**Site Plans – Please provide three sets (required for all projects including remodels):**

- Property lines, adjacent street names, easement locations and types, north arrow, drawn to scale, (such as 1" = 20') and lot area in square feet.
- All site related improvements including grading and erosion control (if ground disturbance is proposed).
- All existing and proposed structures on site with distances from property lines and other structures. (Clearly show that items installed as part of the permit do not extend beyond the boundary of the site).
- Utilities including gas lines, sewer lines, water lines, power lines, power poles, street lights, and water meters.
- Location, dimensions, and area (in square feet) of all existing and proposed paving.
- Landscaping, proposed and existing as required by land use review or Zoning Code for project, and erosion control plan (if any ground disturbance). Indicate any waterways and wetlands areas on property.
- Show existing and proposed finished grade based on spot elevations and two foot contours over entire site and extending five feet onto surrounding properties.
- Indicate all projections exceeding 24" from exterior walls including overhangs, awnings, etc.
- Any work shown in the public right-of-way shall be referenced to an ROW permit and shall be shaded black to clearly indicate that scope of work is not included in current application. Ensure no "build notes" are included for those items shaded black.
- Parking lot layout with required spaces, including accessible and van accessible spaces. Show all accessible routes into the structure, throughout the site, to all structures, mailboxes, any facilities onsite and accessible route to the right-of-way.
- Indicate building surface coverage calculations – lot and footprint square footage and percentage of lot coverage.

**Architectural/Construction Drawings – Please provide three sets (Minimum Requirements)**

**Any building resulting in the footprint of 4,000 square feet or greater OR with a ceiling height 20' or more to be designed by an Oregon Registered Design Professional, Engineer's or Architect's seal and signature. All change in occupancy permits are to be designed by an Oregon Registered Design Professional, Engineer's or Architect's seal and signature.**

- 1. *Cover Sheet* – Building Information
  - a) Complete code summary.
  - b) Specify model code information.
  - c) Construction Type.
  - d) Number of stories and total height in feet.
  - e) Building square footage. (*per floor and total*)
  - f) OSSC Occupancy Type. (*show all types by floor and total*)
  - g) Mixed-use ratio. (*if applicable*)
  - h) Occupancy load calculation. (*show for occupancy type and total*)
  - i) List work to be performed under this permit and deferred items.
  - j) List Design Professional, Architects, Structural Engineers, Owner, Developer, and any other Design Members.
- 2. *Floor Plan*
  - a) Specify use of each room and/or area.
  - b) Include occupant load occupancy calculation for every floor, room, and/or space.
  - c) Identify all new, existing, and eliminated exits.
  - d) Show maximum travel distance and all fire life safety requirements on egress plans.
  - e) Show locations of all permanent rooms, walls, and shafts.
  - f) Note uses of adjacent tenant spaces.
  - g) Provide door and door hardware schedules.
  - h) Identify location of all new walls, doors, windows, etc.
  - i) Provide details and fire rated assembly numbers for any fire resistive assemblies.
  - j) Indicate all rated walls, doors, windows, and penetrations.

- k) Provides a legend that distinguishes existing walls, walls to be removed, and new walls.
  - l) Show location of appliances that can generate grease vapors.
  - m) Identify fire alarm panel and remote annunciator(s).
  - n) Include basement areas (*whether they are to be used for this project or not*).
  - o) Show fire sprinkler riser rooms.
  - p) Identify location of specialty suppression systems.
  - q) Show accessible requirements, existing and proposed.
3. *Reflected Ceiling Plan*
- a) Provide ceiling construction details.
  - b) Show location of all emergency lighting and exit signage.
  - c) Include lighting fixture schedule.
4. *Framing Plan & Stair Details*
- a) Specify size, spacing, span, and wood species or metal garage for all stud walls.
  - b) Indicate all wall, beam, and floor connections.
  - c) Include stair section showing rise, run, landings, headroom, handrail, and guardrail dimension.
5. *Plumbing, Electrical, and Mechanical Plans*
- a) Plumbing, Electrical, and Mechanical plans are to be included with plan submittal.
6. *Storage Racks*
- a) Structural calculations required for seismic bracing of racks 8 feet or greater in height.
  - b) Show the positive connection to floor and/or walls for racks 8 feet or less in height.

**Specific Requirements – Special Conditions**

**1. Egress Lighting**

If there is a requirement to complete an egress lighting inspection, we offer this service after hours for those customers interested in not having to ‘black-out’ the facility for inspection. Additional fees are required for after-hours inspections. This inspection may be paid for as part of your total permit costs, at your discretion or paid for at the time of the actual inspection. By signing here you are requesting that the inspection be charged at current after hour’s fees to be paid at the time of permit issuance. Any requests for refunds will be subject to the current Linn County Planning and Building refund policy.

\_\_\_\_\_  
Signature

\_\_\_\_\_  
Printed Name

**2. Special Inspections**

Any commercial project requiring special inspections by the design professional and/or by State code, is required to submit a complete Special Inspection and Testing Agreement *before* permit issuance.

**3. Medical Gas Plans**

Show location of all piping, valves, vacuum pumps, and compressors. Show size and type of all piping and fittings. Show location and type of all alarms and outlets. Show location and volume of all supply gas. Provide specifications of vacuum pumps and compressors and ventilation requirements for storage areas.

Will there be use of procedures that render a patient incapable of unassisted self-preservation?

- Yes       No

\*Example may include the use of general anesthesia which could result in a patient becoming incapable of recognizing a fire emergency or of immediately leaving the building without assistance.

**4. Subcontractor Applications**

All mechanical, plumbing, and electrical permits will require an application to be completed by the sub-contractors before the total permit cost can be calculated and before the permit can be issued.

**5. All Restaurants & Food Service Establishments (Including Small Deli Types) Require Grease Interceptors**

*Plans for grease interceptors must include the following items:*

Floor plan showing all plumbing fixtures to ¼ scale, Specific use for each fixture, How each fixture will be plumbed and vented, The type of food to be served, Cleaning procedure for kitchen cooking appliances and floors, provide proposed size of interceptor, provide drainage fixture units for all fixtures that will be going through interceptor, and capacity, in gallons, of fixtures draining into interceptor.

**6. Food-Related Activities**

Any food or beverage-related commercial activity will require licensing and inspection by either Linn county Environmental Health Division or the Oregon Department of Agriculture's Food Safety Division. Plan Review by one of these two agencies will also be required.

Food Service (i.e. restaurant, deli, café, coffee shop, brew pub, catering operation, mobile food vendor, etc.) Businesses of this type would contact Linn County Environmental Health Division at (541) 967-3821.

Food or Beverage Processing, Manufacturing, Sales, Warehousing/Distribution (i.e. grocery store, convenience store, home-based food business, beverage production and/or sales; includes wine, non-alcoholic beverages, bottled water, brewery, etc.), food products warehouse, bakery, meat market, food processing (includes the manufacture and/or handling of any food product). Businesses of this type would contact Oregon Department of Agriculture Foods Safety Division at (541) 923-0754.

**7. Potable Water**

All commercial water services must have a backflow prevention assembly installed for premise isolation and initial or annual testing must be current and on file with the **Public Works Department**. Existing facilities which do not have a backflow prevention assembly installed, do not have the proper assembly type installed or do not have current testing on file will be required to resolve prior to final inspections of any permitted renovations as part of the permit approval conditions. Please see below for a list of uses which require specific assembly installations:

*The Following Businesses Require Isolation by an Approved Air Gap or Reduced Pressure Principle Type Assembly:*

Agriculture use, beverage bottling plants, auto wash, chemical manufacturing, commercial laundries and dry cleaners, film processing plants, food processing plants, laboratories, metal plating industries, mortuaries, petroleum processing or storage plants, wastewater lift and pumping stations and treatment plants, medical facilities including but not limited to hospitals, medical clinics, nursing homes, veterinary clinics, dental clinics & blood plasma centers.

*Premises with any of the following conditions:*

Both reclaimed and potable water are used, irrigation systems which use chemical additions directly into water system, pressured piping is used to convey liquids other than potable water and the piping is installed in proximity to potable water supply, an auxiliary water supply is connected to potable water supply, water is being treated by the addition of chemical or other additives.

**8. Waste Water Pretreatment**

Have you confirmed the industry which is being permitted is in compliance with Local, State, and Federal regulations for discharge of waste water? It is the responsibility of the application to complete the confirmation.

For information or guidance in this matter, contact Linn County Environmental Health at (541) 967-3821 or visit [www.co.linn.or.us](http://www.co.linn.or.us)

For a list of industries required to comply with pretreatment requirements visit <https://www.epa.gov/eg/industrial-effluent-guidelines>.

**9. Address**

A valid physical address is required on the application. If the building includes suites or if there are multiple buildings on the site, the following information will be required with the Constuction Permit Appplication. Provide minimum 8 1/2" X 11" floor plan including suite number layout with any existing suite numbers in use and/or, if more than one building on lot, provide, minimum 8 1/2" X 11" site plan including any existing building identifiers. Floor plan must include all tenant spaces, including tenant business names. Please contact the Linn County GIS Department at (541) 924-6903 with any questions.

Building does not have suites and site does not have multiple buildings.

\*\*\*Additional fees may be charged for phased construction, deferred submittals and project revisions.

*I do hereby certify that all information hereon is true and accurate and that I am responsible for submitting the applicable items to the appropriate departments.*

Agent/Builder

or

Owner

\_\_\_\_\_  
Signature – Agent

\_\_\_\_\_  
Signature – Owner

\_\_\_\_\_  
Printed Name – Date

\_\_\_\_\_  
Printed Name – Date

What is your association to this project? (i.e: business owner, general contractor, property owner, designer, etc.)

\_\_\_\_\_

APPLICATION FOR STRUCTURAL PERMIT	<u>DEPARTMENT USE ONLY</u>	
	Permit #:	
		Date:

This permit is issued under OAR 918-440-0050. Permits expire if work is not started within 180 days of issuance or if work is suspended for 180 days.

JOB SITE INFORMATION	OWNER INFORMATION	
Address:	I am the property owner doing my own work (initial): Owner Name:	
City:		
Parcel #:	Mailing address:	
Planning Approval: Yes No Conditions: Yes No	City/State/ZIP:	
Is property inside city limits: Yes No City:	Phone:	Cell:
Is property in a flood plain <input type="radio"/> Yes <input type="radio"/> NO	Email:	

OTHER APPROVALS		
Fire Department Approval	Roads Department	Environmental Health/Septic
Information verified/approved? <input type="radio"/> Y <input type="radio"/> N	OY ON Approval: Permit number	Information verified/approved? <input type="radio"/> Y <input type="radio"/> N
Approval: Date: Conditions: Yes No		Approval: Date:

<b>(1) Valuation Information</b>	
(a) Job description:	
(b) Occupancy:	
(c) Construction type:	
(d) Square feet:	
Cost per square foot (April ICC):	
Type of Work:	<input type="radio"/> New <input type="radio"/> Alteration <input type="radio"/> Addition <input type="radio"/> DeoommÉsiono Repair
(g) Is this a foundation ONLY permit?	<input type="radio"/> Yes <input type="radio"/> No
(h) Is this a plan review ONLY?	<input type="radio"/> Yes <input type="radio"/> No
Total valuation:	

<b>(2) Building Fees</b>		Contractor:	
(a) Permit fee:		Address:	
(b) 12% surcharge:		City/State/ZIP:	
<b>(3) Plan Review</b>		Phone:	
(a) Plan review (permit fee x 65% )		Email:	
(b) Fire & Life Safety (permit fee x 40% )		BCD license:	
Subtotal of fees above:		CCB license:	
<b>(4) Miscellaneous Fees</b>			
(a) Seismic review — permit fee x 0.01			
(b) Technology fee 2.5% of total			
Total Due:			

I hereby certify that, to my knowledge, the above information is true and correct. All work to be performed shall be in accordance with all governing laws and rules.

Applicant name:	
Mailing Address:	
City/State/ZIP:	
Phone:	
Email:	
Signature:	Date:


Planning conditions	

Fire department conditions	

EH Conditions	

Roads Dept. Conditions	



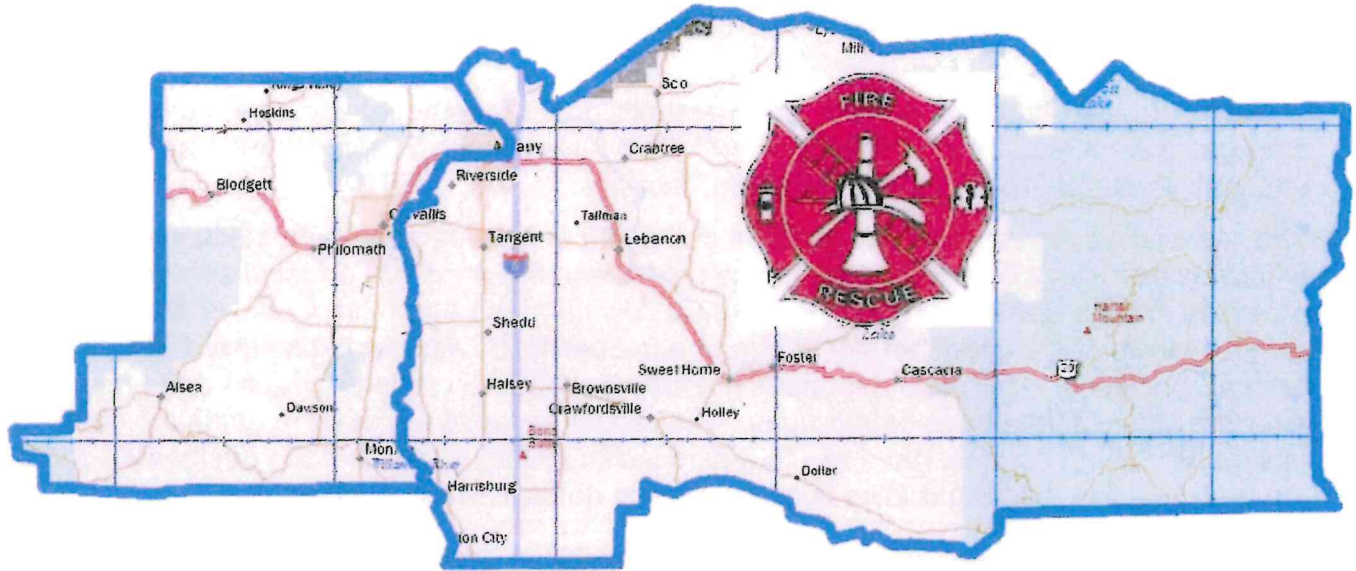

# **Linn and Benton County Fire Departments Access and Water Supply Application Guide**

**March 2023**

**Based on 2022 Oregon Fire Code  
Approved by the Linn and Benton County Fire Defense Boards**

# TABLE OF CONTENTS

<b>SECTION 1: FIRE DEPARTMENT APPARATUS ACCESS ROADS</b> .....	<b>4</b>
1.1 Definitions.....	4
1.2 Fire Department Apparatus Access; General Regulations and Scope.....	4
1.3 Proximity of Buildings to Fire Apparatus Access Roads .....	5
1.4 Multiple Fire Apparatus Access Roads & Road Separation.....	5
1.5 Fire Apparatus Access Road Widths and Vertical Clearances .....	7
1.6 Aerial Fire Apparatus Access Road Widths .....	8
1.7 Fire Apparatus Access Road Surfaces and Load Capacities .....	9
1.8 Fire Apparatus Access Road Dead-Ends and Turnarounds.....	10
1.9 Bridges & Elevated Surfaces.....	11
1.10 Fire Apparatus Access Road Grades and Angles of Approach & Departure .....	12
1.11 Fire Apparatus Access Road Turning Radius.....	12
1.12 Gates on Fire Apparatus Access Roads .....	13
1.13 No Parking Signs & Painted Curbs .....	13
1.14 Fire Apparatus Access Roads during Construction Operations.....	14
<b>SECTION 2: WATER SUPPLIES FOR SUPPRESSION OF FIRES</b> .....	<b>15</b>
2.1 Definitions.....	15
2.2 Fire Flow Requirements for Buildings in Protected Areas WITHOUT Adequate and Reliable Water Systems .....	15
2.3 Fire Flow Requirements for Buildings in Protected Areas WITH Adequate and Reliable Water Systems.....	16
2.4 Water Supply during Construction or Demolition Operations.....	16
<b>SECTION 3: FIRE HYDRANTS AND FIRE DEPARTMENT CONNECTIONS</b> .....	<b>17</b>
3.1 Fire Hydrants and Fire Department Connections .....	17
3.2 Fire Hydrant Location and Distribution .....	17
<b>SECTION 4: OTHER FIRE SERVICE FEATURES</b> .....	<b>18</b>
4.1 Premises Identification .....	18
4.2 Key Boxes .....	18
4.3 Fire Department Access to Equipment .....	18
<b>APPENDIX A-1: JURISDICTION CONTACT INFORMATION</b> .....	<b>19</b>

c. Where there are no more than two dwellings (Group R-3) or utility (Group U) structures served by a fire apparatus access road.

2. Fire apparatus access roads shall be clearly delineated on submitted site plans and/or civil drawings. Plans shall contain sufficient information to allow the fire code official to conduct a thorough review.


### 1.3 Proximity of Buildings to Fire Apparatus Access Roads

#### Requirement:

The fire apparatus access road shall extend to within 150 feet of all portions of the facility and all portions of the exterior walls of the first story of the building as measured by an approved route around the exterior of the building or facility. **Oregon Fire Code Chapter 5**

An approved route generally follows the outline of a building and is not closer than 10 feet from the nearest edge of the building. This route follows where fire hoses may be deployed during fire operations.

#### Specifications:

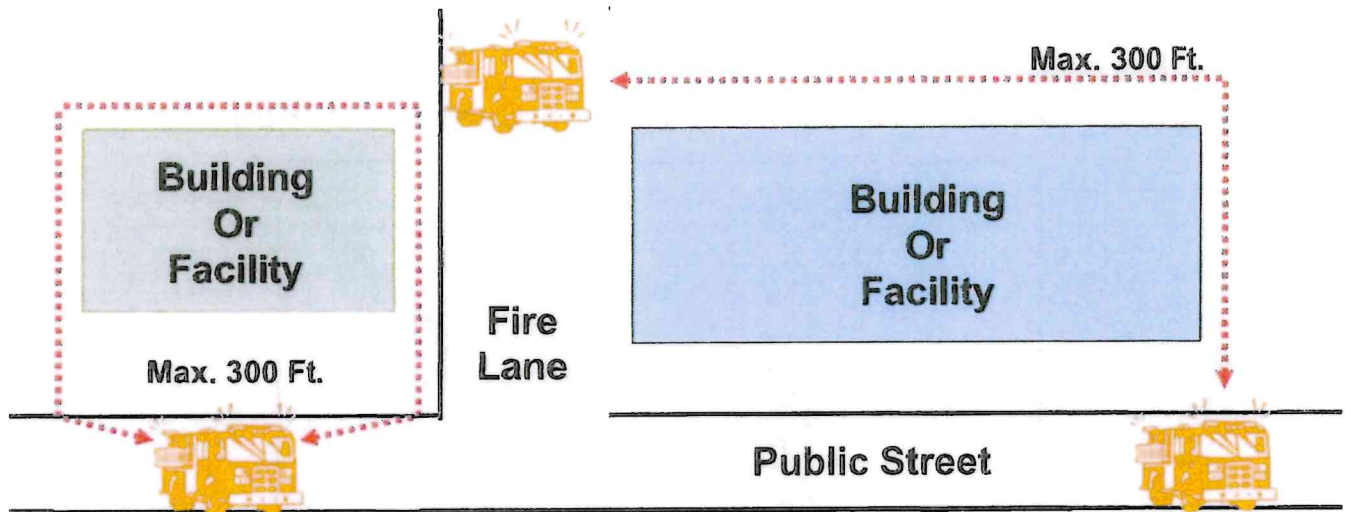

### 1.4 Multiple Fire Apparatus Access Roads & Road Separation

#### Requirement:

More than one fire apparatus access road may be required, based on the potential for impairment of a single road by vehicle congestion, condition of terrain, climatic conditions or other factors that could limit access. Access roads shall be located as required by the fire code official. **Oregon Fire Code Appendix D**

#### Specifications:

Refer to the Oregon Fire Code, Appendix D for specifications.

1. Two access roads are required under the following conditions:

- a. One- and two-family dwellings (Group R-3) where there are more than 30 dwelling units with an exception for installation of automatic fire sprinkler systems.
  - The number of dwelling units accessed from a single fire apparatus access road shall not be increased unless fire apparatus access roads will connect with future development, as determined by the fire code official.


## 1.5 Fire Apparatus Access Road Widths and Vertical Clearances

### Requirement:


All fire apparatus access roads must have a drivable surface for fire vehicle travel that is wide enough to allow their full, complete, and instant use during fire and other emergencies. **Oregon Fire Code Chapter 5**

### Specifications:

1. Fire apparatus access roads shall have an unobstructed driving surface width of not less than 20 feet (26 feet adjacent to fire hydrants) and an unobstructed vertical clearance of not less than 13 feet 6 inches.

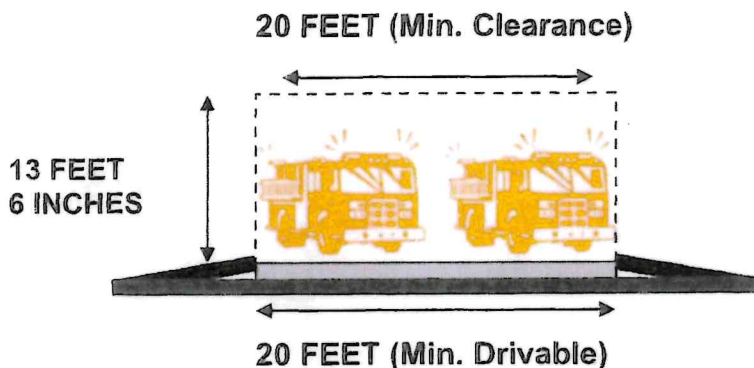

**EXCEPTION:** When serving two or less dwelling units or accessory buildings, the driving surface may be reduced to a width per the AHJ, although the unobstructed width shall be 20 feet. Turning radii for curves and turnarounds on reduced width roads shall be not less than 28 feet and 48 feet respectively, measured from the same center point.

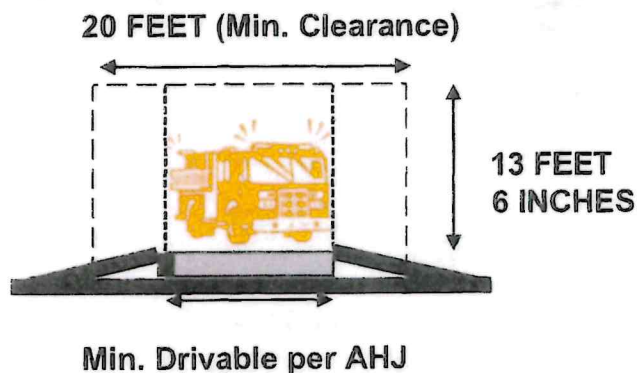


### Requirement:

When a driveway exceeds 400 feet in length with a drivable surface less than 20 feet, turnouts shall be provided, unless otherwise approved by the fire code official. **Oregon Fire Code Chapter 5**

### Specifications:

- a. Turnouts shall be 20 feet wide and 40 feet long at the widest part.
- b. Turnouts shall be located no more than 400 feet apart unless approved by the fire code official.
- c. The distances between turnouts, road intersections, and turnarounds may have the length modified based on visibility and line of sight distances.
- d. Visual indicators such as reflective markers shall be located to delineate the location and extent of turnouts.

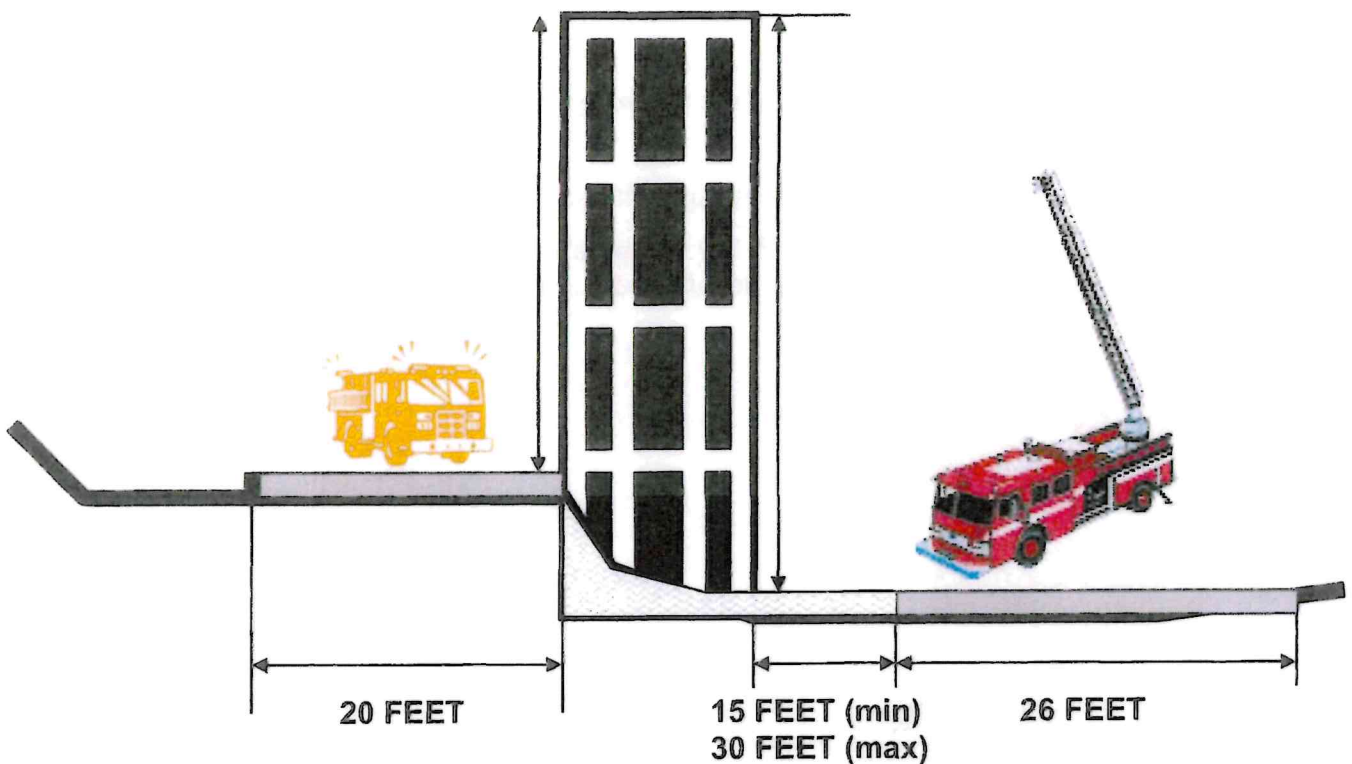

## 1.7 Fire Apparatus Access Road Surfaces and Load Capacities

### Requirement:

Fire apparatus access roads shall be designed and maintained to support the imposed loads of fire apparatus and shall be surfaced so as to provide all-weather driving capabilities. **Oregon Fire Code Chapter 5**

### Specifications:

Refer to **Oregon Fire Code Appendix D** for specifications.

1. Fire apparatus access roads shall be constructed of an all-weather surface (asphalt, concrete or other approved driving surface) that meets the following:
  - a. Easily distinguishable from the surrounding area by markings acceptable to the fire code official. Markings may include plantings, signs, or other arrangements acceptable to delineate the limits of fire access driving surfaces.
  - b. Capable of supporting not less than a 75,000-pound live load (gross vehicle weight).
  - c. The weight limit specified in section 1(b) above may be increased based upon the actual weight of fire apparatus vehicles serving the jurisdiction which provides structural fire protection services to the location.
2. Point loads may also need to be considered when designing fire apparatus access roads due to fire operations involving aerial fire apparatus which require the use of specialized jacking pads and outriggers.
3. The designed capacity of private roads and driveways must be documented in writing and shall be included with site plans and/or civil drawings.
4. Fire Apparatus Access Roads must be constructed and maintained as designed. An on-site inspection may be required by the fire code official and shall be performed by a registered design professional whenever conditions warrant.


## 1.9 Bridges & Elevated Surfaces

### Requirement:


Bridges that are part of fire apparatus access roads shall be constructed and maintained in accordance with AASHTO (American Association of State Highway and Transportation Officials) *Standard Specification for Highway Bridges*. **Oregon Fire Code Chapter 5**

### Specifications:

1. Bridges shall be not less than 20 feet in drivable width.

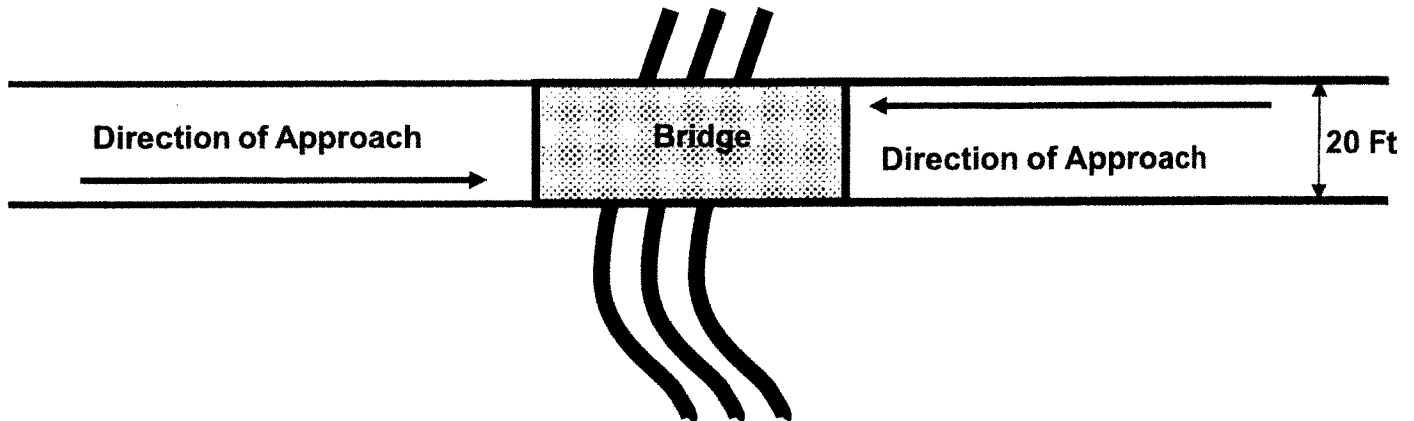

**EXCEPTION:** When serving two or less dwelling units or accessory buildings, the driving surface may be reduced to a width per the AHJ. Vehicle turnouts shall be constructed adjacent to bridges. Turnouts shall be located not less than 20 feet from each end of the bridge for cueing of fire vehicles that must cross.

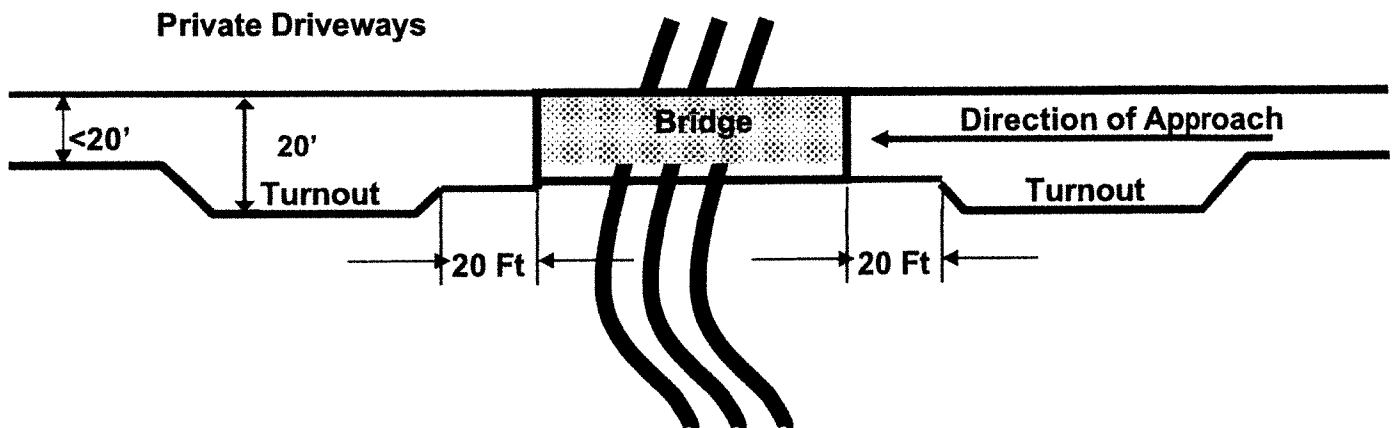

2. All bridges shall be designed for a live load sufficient to carry the imposed loads of fire apparatus in accordance with this document.
3. Newly constructed bridges shall be designed by a registered design professional.
4. Where elevated surfaces designed for emergency vehicle use are adjacent to surfaces which are not designed for such use, approved barriers, approved signs or both shall be installed and maintained to delineate the drivable surface. Where signs are required, they shall comply with the current *Manual on Uniform Traffic Control Devices* adopted by the State of Oregon.
5. Maintenance of existing bridges and elevated surfaces shall be the responsibility of the person or persons that have ownership of the bridge or elevated surface.

3. Both the inside and outside turning radius shall be measured from the same center point.

### **1.12 Gates on Fire Apparatus Access Roads**

#### **Requirement:**

The fire code official is authorized to require the installation and maintenance of gates or other approved barricades across fire apparatus access roads. **Oregon Fire Code Chapter 5**

#### **Specifications:**

Refer to **Oregon Fire Code Appendix D** for specifications.

1. Gates shall be a minimum width of 20 feet wide (12 feet wide for divided roads).
2. Gates shall be of either the swinging or sliding type and may be either a single or double section.
3. Gates shall not reduce the minimum required width of the access road width when in a fully open position.
4. Gates that are power operated shall require the installation of a means to open the gate when there is a loss of power to the gate operating device. Gates shall be constructed to allow manual operation by a single person.
5. Gates and barricades shall be secured in an approved manner.
  - Gates secured with padlocks or chains and padlocks shall be capable of being opened by means of an approved lock or key box containing keys to the padlocks is installed at the gate location. As approved by the AHJ.
  - Where powered security gates are installed, they shall have an approved means of emergency operation as per the AHJ. The gates and their emergency operation shall be maintained operational at all times.
  - All security devices shall allow opening without undue delay of fire apparatus during emergencies.
6. Gates shall be set back from roadways not less than 30 feet and shall swing into the roadway that it serves.
7. Gates installed on private driveways, fire lanes, and other fire apparatus access roads shall not cause cross traffic to stop or create a hazardous traffic condition on the roadway when the access road is occupied by emergency apparatus or other large vehicles.
8. Gates components shall be maintained in an operative condition at all times and replaced or repaired when defective.

### **1.13 No Parking Signs & Painted Curbs**

#### **Requirement:**

Approved signs shall be provided for fire apparatus access roads to identify such roads or to prohibit the obstruction thereof. Fire apparatus access roads shall be marked in an approved manner as specified by the fire code official and in accordance with this section. **Oregon Fire Chapter 5**

#### **Specifications:**

Signs shall comply with the current *Manual on Uniform Traffic Control Devices* adopted by the State of Oregon. Below are examples of acceptable signage. Signs shall meet the specifications for the R7 series and shall have red writing on a white reflective background.

Signs shall be a minimum size of not less than 12 inches by 18 inches.

Signs shall be constructed of 0.080 thickness aluminum.

Reflective sheeting shall be high intensity prismatic or better.

## SECTION 2: WATER SUPPLIES FOR SUPPRESSION OF FIRES

### **2.1 Definitions**

The definitions included in this section are to assist the reader with understanding terms that are used when fire flow requirements apply to buildings and facilities. Terms include those from the Oregon Fire Code as well as terms that are used in this document.

1. **Adequate And Reliable.** The fire flow rate as measured when water is flowing at not less than 1,500 gallons per minute and at not less than 20 pounds per square inch (psi) residual pressure.
2. **Fire Flow.** The flow rate of a water supply, measured at not less than 20 pounds per square inch (psi) residual pressure that is available for fighting fires.
3. **Protected Areas.** Geographic areas where a service or an agency has been established for the purposes of providing fire suppression services for buildings and other structures. Examples of agencies typically include public fire departments, rural fire protection districts, and private fire protection services.
4. **Fire Area** The living portion of a residence, plus attached garage/shop, covered porches/decks, usable attic, or basement space (capable of storage or future living area) shall constitute the total fire area in square feet.

### **2.2 Fire Flow Requirements for Buildings in Protected Areas WITHOUT Adequate and Reliable Water Systems**

#### **Requirement:**

For residential dwellings with fire areas of 3,600 square feet or more, an approved water supply capable of supplying the required fire flow for fire protection shall be provided to premises upon which facilities, buildings or portions of buildings are hereafter constructed or moved into or within the jurisdiction. **Oregon Fire Code Chapter 5**

#### **Specifications:**

Refer to **Oregon Fire Code Appendix B** for specifications.

1. The provisions of **OFC Appendix section B107** are intended for use by the fire code official in protected areas in which adequate and reliable water supply systems do not exist or where water supply systems are incapable of meeting the provisions specified in this document.
2. When determining the fire flow for buildings in these areas, the fire code official is authorized to utilize any of the following nationally recognized methods:
  - NFPA 1142, *Standard on Water Supplies for Suburban and Rural Fire Fighting*, 2022 Edition.
  - The International Wildland Urban Interface Code; 2021 Edition.
  - ISO (Insurance Services Office) Document for Determining Needed Fire Flow, 2014 Edition.

#### **Uniform Alternate Construction Standard (UACS) for One- and Two-Family Dwellings:**

The Fire code Official has the authority to recognize alternative and equivalent methods and materials of design related to access and water supply as outlined in Chapter 1 or the Oregon Fire Code (Duties and Powers of the Fire Code Official). This references provisions of OAR 918-480-0125(4)(a-e): NFPA Standard 13D fire suppression systems, installation of additional layers of 5/8 inch Type-X gypsum, fire-resistive compartmentalization of dwelling fire areas, fire resistive exterior wall and roofing components, and/or fire separation containment in accordance with the default standards of the Wildland-Urban Interface rules (OAR 629-044-1060).



# SECTION 3: FIRE HYDRANTS AND FIRE DEPARTMENT CONNECTIONS

## 3.1 Fire Hydrants and Fire Department Connections

### Requirement:

Fire hydrants and fire department connections shall comply with the Oregon Fire Code as approved by the AHJ. **Oregon Fire Code Chapter 5**

## 3.2 Fire Hydrant Location and Distribution


### Requirement:

Where a portion of the facility or building hereafter constructed or moved into or within the jurisdiction is more than 400 feet from a hydrant on a fire apparatus access road, as measure by an approved route around the exterior of the facility or building, on-site fire hydrants and mains shall be provided. **Oregon Fire Code Chapter 5**

### Specifications:

Refer to **OFC Appendix C** for specifications.

1. Fire hydrants shall be provided along required fire apparatus access roads and adjacent public streets as required by the fire code official.
2. Where dwellings (Group R-3) or utility (Group U) structures only are located such as in residential subdivisions, the distance from a hydrant shall be not more than 600 feet.
3. Where buildings are equipped throughout with an approved automatic fire sprinkler system installed to either NFPA 13 or NFPA 13R, the distance from a fire hydrant shall be not more than 600 feet.
4. The number of fire hydrants available including consideration of existing fire hydrants, shall be in accordance with **Oregon Fire Code Appendix C**.
5. Distribution of fire hydrants shall be in accordance with **Oregon Fire Code Appendix C**.

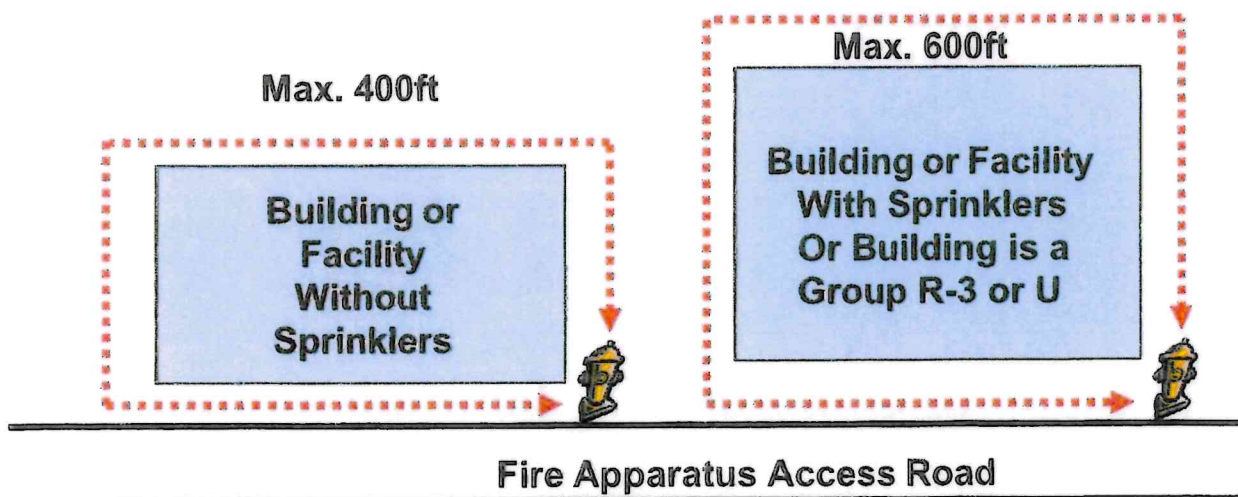

# APPENDIX A-1: JURISDICTION CONTACT INFORMATION

These are the addresses for the local and state fire code officials in Linn and Benton Counties. The development of this document is a joint effort among the listed jurisdictions.

## Benton County Fire Districts & Fire Departments

	Adair RFPD	541-745-7212
	Alsea RFPD	541-487-8701
	Blodgett Summit RFPD	541-453-4406
	Corvallis FD	541-766-6961
	Hoskins-Kings Valley RFPD	541-929-2111
	Monroe RFPD	541-847-5170
	Philomath F&R	541-360-0032
	Albany FD	541-917-7700
Benton County:	Building Division	541-766-6819
	Planning Division	541-766-6819
City of Adair:	Building Department	541-766-6819
	Planning Department	541-766-6819
City of Alsea:	Building Department	541-766-6819
	Planning Department	541-766-6819
City of Blodgett-Summit:	Building Department	541-766-6819
	Planning Department	541-766-6819
City of Corvallis:	Development Services	541-766-6929
	Planning Division	541-766-6908
City of Hoskins-Kings Valley:	Building Department	541-766-6819
	Planning Department	541-766-6819
City of Monroe:	Building Department	541-766-6819
	Planning Department	541-766-6819
City of Philomath:	Building Department	541-929-6148
	Planning Department	541-929-6148

## Oregon State Fire Marshal Office

Jason Cane, Regional Supervising Deputy 503-507-4495

# FIRE DEPARTMENT EMERGENCY RESPONSE VEHICLE ACCESS AND WATER SUPPLY WORKSHEET

THIS SECTION IS MEANT TO SERVE AS INFORMATION IN THE COMPLETION OF THE WORKSHEET

Residential, Commercial, and Agricultural structures SHALL provide reliable water and sufficient access to responding emergency vehicles. This code requirement falls under the Authority Having Jurisdiction (AHJ) being the Fire Department (FD) which has the heaviest and longest emergency response vehicles. Fire Safety & Life Safety is afforded to all within the State of Oregon, and FD Access & Water Supply is the minimal standard before any project begins. Access and Water Supply is required **during** the Land Development stage and addressed **before** designing the site and structure. The Fire Department has weight, length, height, width, and elevation requirements for their vehicles.

Water is the tool of choice for fighting fires. Firefighters require a reliable source of water for firefighting activities that protect them from fire, support life rescue operations, minimize property losses, and protects the community from fire spread. Reliable water sources are normally in the form of fire hydrants; however, some projects are outside of a municipal water grid. In support of allowing structures out of reach from the grid, the fire department allows for a source of water to be established on the property to supply the firefighters and equipment, for a minimum amount of time, based upon the location and size of the fire area. Well water can be used to supply the amount of water required even though their gallons per minute is insufficient to supply firefighting equipment directly.

**This water supply is required for the entire life of the structure, or until a reliable water source or grid becomes available near-by.**

All projects receive an access and water supply review, in which requirements may be made by the local Fire Authority. Alternate methods and materials (AM&M) may be submitted to the local Fire Authority for consideration. AM&M's for lots created on or after July 2, 2001 will require the Building Official's approval during building permit plans review. Make sure all AM&M's effecting the building plans are reflected accurately and included in the building design. Any changes to the project after the plans review has been completed must be resubmitted and reviewed for compliance and approval.

When filling out the worksheet, please be thorough with the requested information as the information will aid the local Fire Authority in the access and water supply review of the project. Each project is reviewed independently and is in no way precedent-setting on future projects. Please consult your local Fire Authority if you have any questions. Please include the following documents with this worksheet:

- A site plan that clearly identifies road width and segment lengths (as applicable), grades, turnout(s) as applicable, turnaround as applicable, and location of any bridge/culvert.
- A floor plan for the dwelling indicating total sq. ft. of living area, covered porch(es) or deck(s), attached garage/shop, attic/basement, etc. If using a separation wall, indicate proposed location(s) and specifications.

## LINN-BENTON FIRE PROTECTION GUIDE:

<https://www.philomathfire.com/files/d7641c375/Linn+Benton+Fire+Protection+Guide+20230316.pdf>

## FIRE AUTHORITY NOTES/CONDITIONS:



LINN COUNTY PLANNING AND BUILDING DEPARTMENT

Steve Wills – Director
Rick Goff – Building Official

Room 114, Linn County Courthouse
PO Box 100, Albany, Oregon 97321
Phone 541-967-3816, Fax 541-926-2060

Floodplain Elevation Certificate Worksheet
(Pre-Development Form)

Property Information Twp ( ) S) Range ( ) Section ( ) Tax lot ( )

Construction Address City Zip code

Development Permit number Type of Development

Property owner Phone number

Mailing address City Zip code

Floodplain Map Information

FIRM Map Base Flood Elevation Numbered A Zone Unnumbered A zone

Floodway Not within floodplain Panel Number

This section to be completed by a registered Oregon Surveyor

Surface Elevation at development site Adjacent Grade Elevation

Surveyor Signature

Dated Registration Number

Staff Comments


Multiple horizontal lines for staff comments.

Place Stamp Here

Staff Determination by

Date

**NOTE: All plot plans must be drawn to scale**

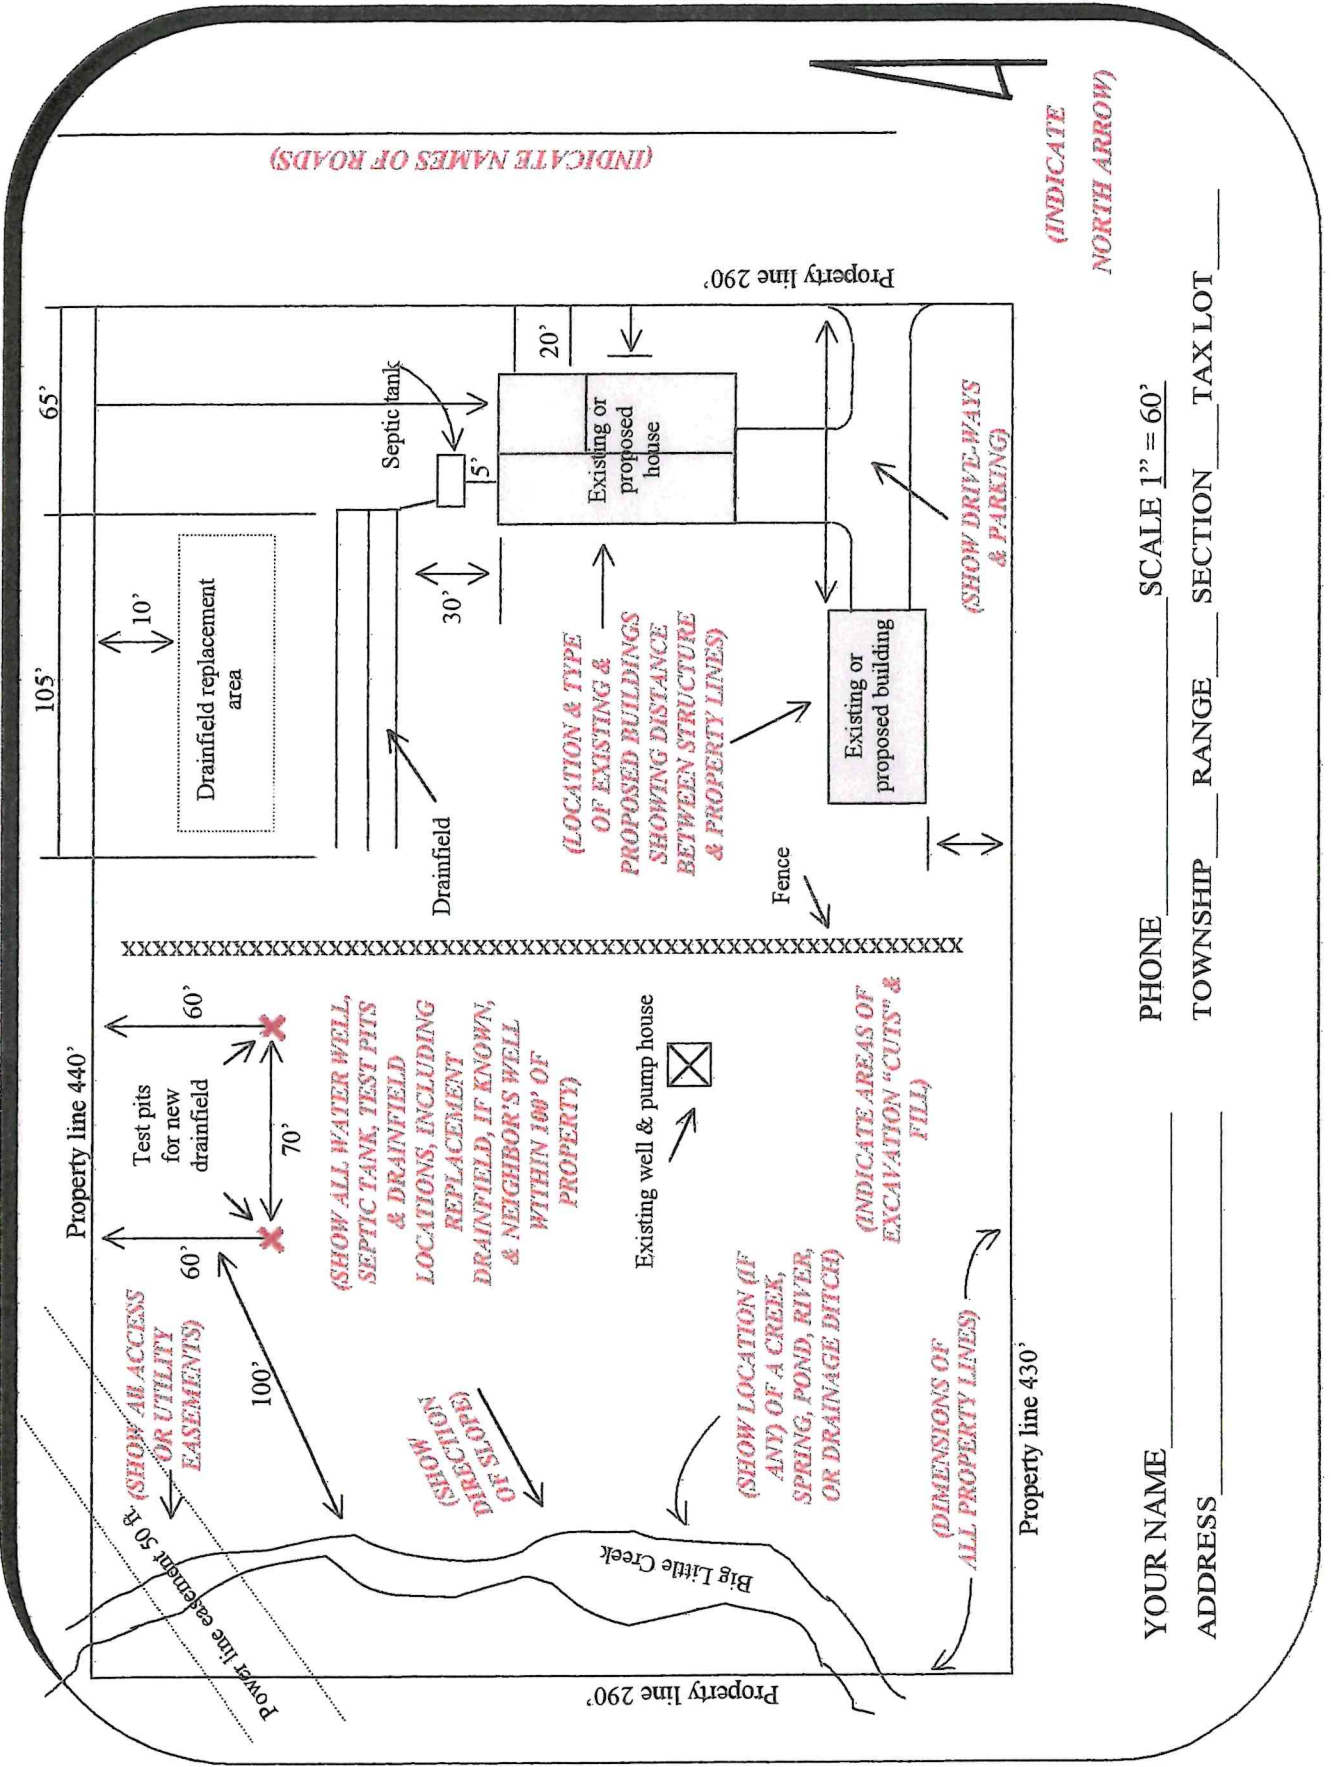

YOUR NAME \_\_\_\_\_ PHONE \_\_\_\_\_ SCALE 1" = 60'  
 ADDRESS \_\_\_\_\_ TOWNSHIP \_\_\_\_\_ RANGE \_\_\_\_\_ SECTION \_\_\_\_\_ TAX LOT \_\_\_\_\_

G:/applications/plotplan

**SAMPLE PLOT PLAN**

11" x 17" OR 8 1/2" x 11" SHEET OF PAPER